



# Greengate

## NeoSwitch Dual Technology Dual Relay Occupancy Sensing Wall Switch (Ground Required)



### RoHS

Model # ONW-D-1001-DMV-W  
 Model # ONW-D-1001-DMV-V  
 Model # ONW-D-1001-DMV-LA  
 Model # ONW-D-1001-DMV-G  
 Model # ONW-D-1001-DMV-B

P/N 9850-000317-01

### General Information

- Read all instructions on both sides of this sheet first
- Install in accordance with ALL local codes
- For indoor use only

### Specifications

**Technology:** Passive Infrared (PIR) and Ultrasonic (US)

**Electrical Ratings:**

120 VAC:

- Incandescent/Tungsten – Max. load: 6.7 amps, 800W, 50/60 Hz
- Fluorescent/Ballast – Max. load: 10 amps, 1200W, 50/60 Hz

Motor Load: ¼ HP @ 125 VAC

277 VAC:

- Fluorescent/Ballast – Max. load: 9.8 amps, 2700W, 50/60 Hz

**Ballast Compatibility:** Compatible with magnetic and electronic ballasts

**No Minimum Load Requirement**

**Time Delays:** Self-Adjusting, 15 seconds/test (10 min Auto), Selectable 5, 15, 30 minutes

**Coverage:** Major motion – 1000 sq. ft.

Minor motion – 300 sq. ft.

**Light Level Sensing:** 0 to 200 foot-candles

**Operating Environment:**

- Temperature: 32° F – 104° F (0° C – 40° C)
- Relative Humidity: 20% to 90% non-condensing

**Housing:** Durable, injection molded housing.

Polycarbonate resin complies with UL 94V0.

**Size:**

- Mounting Plate/Strap Dimensions: 4.195" H x 1.732" W (106.553 mm x 44 mm)
- Product Housing Dimensions: 2.618" H x 1.752" W x 1.9" D (66.5 mm x 44.5 mm x 48.26 mm)

**LED Indicators:** Red LED indicates PIR detection;

Green LED indicates Ultrasonic detection.

### Description

The ONW-D-1001-DMV Occupancy Sensing Wall Switch is a Passive Infrared (PIR) and Ultrasonic (US) motion sensing lighting control and conventional wall switch all-in-one, used for energy savings and convenience.

The sensor combines PIR and US technologies to monitor a room for occupancy.

### PIR Technology

The sensor's segmented lens divides the field-of-view into sensor zones, and detects the changes in temperature that are created when a person, or part of a person as small as a hand, passes into or out of a sensor zone.

### US Technology

The sensor produces a low intensity, inaudible sound. It detects occupancy from changes in the acoustic waves caused by motion, such as reaching for a telephone, turning a page in a book, walking into a room, turning in a swivel chair, etc. The sensor does not respond to audible sound.

Dual Technology sensors ensure the greatest sensitivity and coverage for tough applications thus saving additional energy. PIR is used to turn the lights ON and then either or both technologies are used to keep the lights ON.

The ONW-D-1001-DMV allows the control of two separate loads with one occupancy sensor switch.

**Energy Saver Mode** – Either or both loads may be configured to turn ON manually. The default setting for the second load is Manual ON. This ensures the wall switch only activates one load. If both loads are ON when the sensor times-out, only the primary load will be activated. If the lights were shut OFF manually, the unit will activate the primary load only.

In Automatic ON Mode, the lights turn ON automatically when a person enters the room. In Manual ON Mode, the lights are turned ON by pressing the universally recognized light icon pushbutton. In either mode, the lights stay ON as long as the sensor detects motion in the room. When the room is vacated, the lights turn OFF automatically after a preset time delay interval.

The sensor includes self-adaptive technology that continually adjusts to conditions by adjusting sensitivity and time delay in real-time. By adjusting sensitivity and time delay automatically, the sensor is maximizing the potential energy savings that are available in the particular application.


The Daylighting feature prevents lights from turning ON, when the room is adequately illuminated by natural light. Walk-Through feature maximizes energy savings by not leaving the lights ON after a momentary occupancy. The sensor will switch the lights ON when it detects a person entering the area. If the sensor does not continue to detect motion 20 seconds following the initial activation, it will automatically go to a shorter 2 minute time delay.

**Bathroom Mode** – When selected, bathroom mode keeps the second relay ON for an additional 8 minutes, after the first relay has been turned OFF. Combine this with changing the pushbutton to the light/fan graphic and you now have the universally recognized and easy to use bathroom solution.

**Relay Swap Option** – A common problem in electric wiring is wiring the wrong switch to the wrong load. This can make control of loads confusing to an end user. The Relay Swap option solves the problem by allowing the switch buttons on the face of the unit to be swapped, after the unit is wired and installed.

### Coverage

The ONW-D-1001-DMV is designed for offices up to 300 square feet.

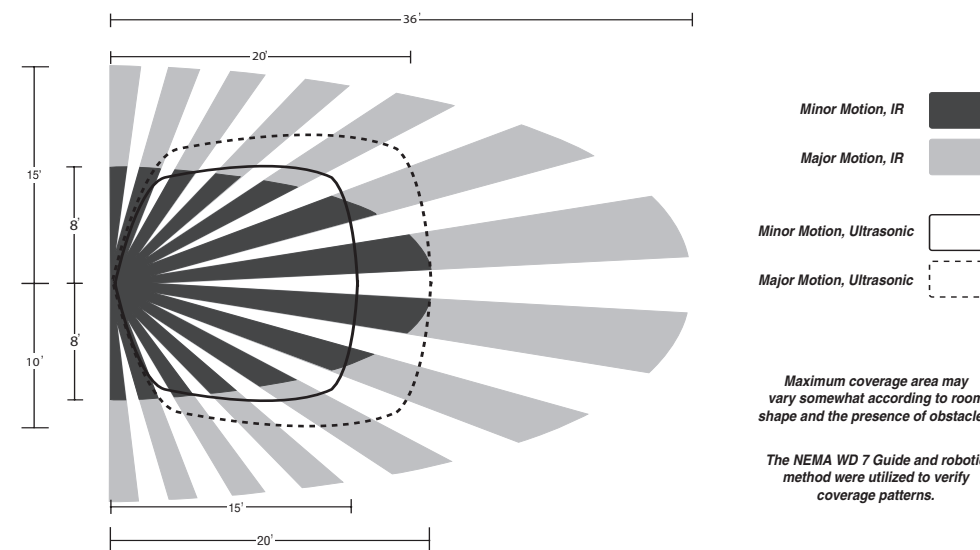


### Location

When installing ONW-D-1001-DMV in a new junction box, choose the switch location carefully to provide optimum coverage of the occupied area. When replacing an existing wall switch, bear in mind that there must be a clear line-of-sight between the sensor and the area to be covered. Avoid pointing the ONW-D-1001-DMV directly into the hallway where it may detect passers-by.

### Installation

The ONW-D-1001-DMV can be installed in any standard single gang box. It may be installed in the same manner as an ordinary wall switch.

- Wire the ONW-D-1001-DMV as described in the wiring section
- Mount the ONW-D-1001-DMV in the junction box

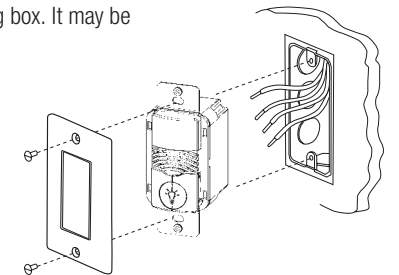

### Wiring


**CAUTION:** Before installing or performing any service on a Greengate system, the power **MUST** be turned OFF at the branch circuit breaker. According to NEC 240-83(d), if the branch circuit breaker is used as the main switch for a fluorescent lighting circuit, the circuit breaker should be marked "SWD." All installations should be in compliance with the National Electric Code and all state and local codes.

*NOTE REGARDING COMPACT FLUORESCENT LAMPS: The life of some compact fluorescent lamps (CFLs) is shortened by frequent automatic or manual switching. Check with CFL and ballast manufacturer to determine the effects of cycling.*

- Make sure power is turned OFF at the branch circuit breaker.
- Wire units as shown in wiring diagrams per applicable voltage requirements.
- Mount unit to wall box.
- Turn power back ON at the branch circuit breaker and wait 2 minutes for the unit to stabilize.
- Make necessary adjustments. (See Checkout and Adjustments section)
- Install wall switch plate.


### Wiring Diagram 1:

120/277 VAC dual level single circuit wiring diagram

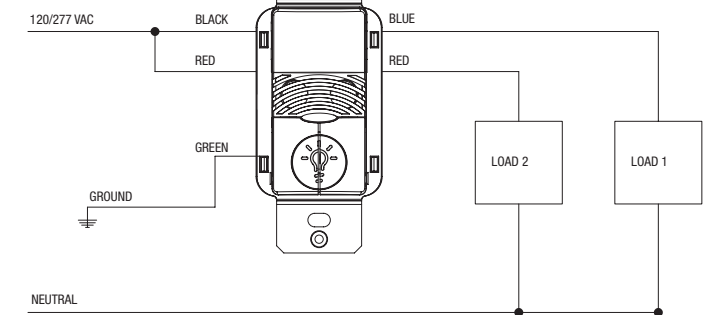


### Wiring Diagram 2:

120/277 VAC dual level dual circuit wiring diagram

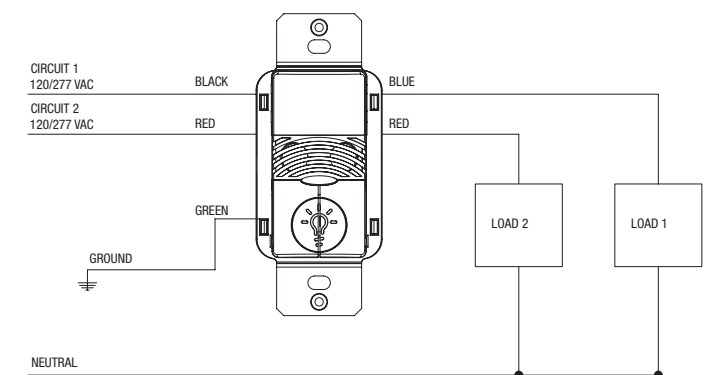

### Wiring Diagram 3: 120/277 VAC dual level single circuit three-way wiring diagram

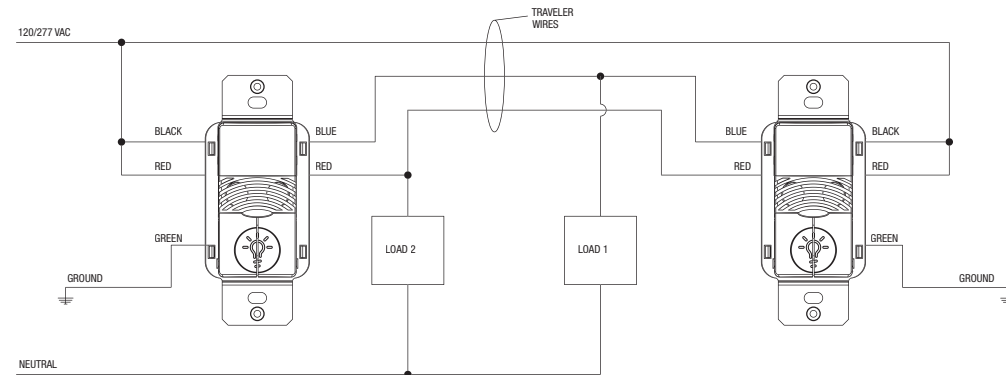


**CAUTION:** If a room is wired for two circuits using two separate hot leads, it is very important to connect only one circuit per relay. Both circuits must be fed from the same phase.

### DIP Switch Settings

DIP Switch Legend												
DIP Switch	Time Delay		Activation		PIR Sensitivity	Walk-Through Mode	Maintain Lights On	Override	Bathroom	Relay Swap	Daylighting	
	1	2	Relay 1	Relay 2							Relay 1	Relay 2
Auto*	▼	▼	Auto	Auto	Full	Disable	Either	Disable	Disable	Normal	Disable	Disable
5 Minutes	▲	▲	Manual	Manual	50%	Enable	Both	Enable	Enable	Swap	Enable	Enable
15 Minutes	▲	▲										
30 Minutes	▲	▲										

\*Self-Adjusts to 10 min. user mode

Default =

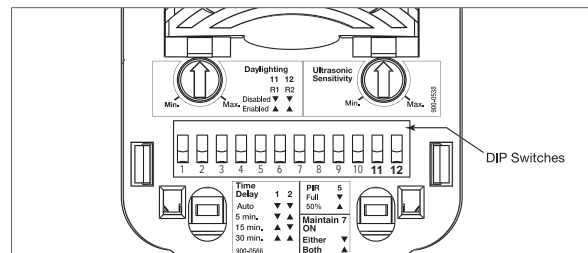

### Checkout and Adjustment

Adjustments should be made with the HVAC system ON so that the installer will be able to detect the effect of airflow on the operation of the ONW-D-1001-DMV. Use only insulated tools to make adjustments.


Immediately after applying power to the lighting circuit, wait approximately two minutes for the switch to power-up and stabilize.

#### Self-Adjust

Sensor is shipped in Self-adjust mode. This applies to time delay, US and PIR sensitivity. In preparation for the Installer Test, the time delay is set to 15 seconds, after the sensor is installed, powered ON and has stabilized, the unit will time-out 15 seconds after the last motion detected. Coverage and sensitivity can be confirmed by watching the Green (US) and Red (PIR) indicator LEDs on the front of the sensor, while moving around the room.

- Walk around the room and monitor LEDs.
- Stand in different parts of the room and wave your hands. LEDs should only turn ON for one second with each motion. (If LED does not turn ON, go to Installer Adjustment Section)
- Stand still three to four feet away from sensor for five seconds. LEDs should not turn ON. (If LED does turn ON, go to Installer Adjustment Section)
- Walk outside the room and wait 15 seconds for the lights to turn OFF. (If lights do not turn OFF go to Installer Adjustments Section)
- Re-enter the room to activate sensor. (If lights do not turn ON go to Troubleshooting Section)
- At this point you can exit the room and let the sensor time-out. When the sensor times-out and is OFF for five minutes, the unit will go to a 10 minute Time Delay user mode setting.

**Note:** To place into Test Mode, toggle DIP Switch 12 out of its current position, wait 3 seconds, and then back into its original position.

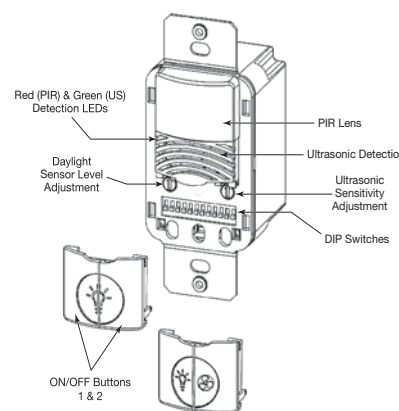

### Installer Adjustments

#### Sensitivity Adjustments

**Ultrasonic Sensitivity** (Green LED) – Using a small flathead screw driver turn the green potentiometer so that the arrow points UP.

- Stand in different areas of the room and wave your hands.
- If the Green LED does not turn ON, increase the US sensitivity by turning the green potentiometer clockwise in small increments. Repeat Step 1.
- Stand still three to four feet away from sensor for five seconds. LED should not turn ON.
- If Green LED turns ON without motion or is constantly ON decrease the US sensitivity by turning green potentiometer counter-clockwise in small decrements. Repeat Step 3.

**Note:** Do Not adjust sensitivity higher than necessary.

#### PIR Sensitivity

- Stand in different areas of the room and wave your hands.
- If the Red LED does not turn ON, check for any obstructions.
- Stand still three to four feet away from sensor for five seconds. LED should not turn ON.
- If Red LED turns ON without motion or is constantly ON adjust PIR sensitivity to 50 % by moving DIP switch 5 up.

#### Field-of-view outside the space

- Adjust PIR sensitivity to 50 % by moving DIP switch 5 up.
- Use non-reflective tape strips to cover the portions of the sensor lens that view outside the space.
- Adjust Ultrasonic sensitivity.

#### Daylight Adjustments

The Daylighting feature prevents the lights from turning ON when the room is adequately illuminated by natural light. If there is enough light in the room, regardless of occupancy, the sensor will hold the lights OFF. If there is not enough light in the room, the sensor will allow the lights to turn ON when occupied. The Daylighting feature allows the selection of which relay to control via daylighting (dual load models only). The sensor will not allow the Daylighting feature to turn the load OFF until the space is vacant if the light level rises above the setpoint and the time delay expires. While in Manual Activation Mode, if someone attempts to turn the load ON and there is sufficient daylight available the Daylighting feature will hold the lights OFF.

- Set the light level when the ambient light is at the level where no artificial light is needed. If this feature is not needed, leave the light level at maximum (fully CW).
- Set DIP switches 11 (Relay 1) and/or 12 (Relay 2) for daylight control.
- With the load(s) ON, put the sensor into Test Mode. To place into Test Mode, toggle DIP switch 12 out of its current position, wait 3 seconds and then back in to its original position.
- Set the light level to minimum (fully CCW).
- Let the sensor time-out so lights are OFF. Enter the space and lights should remain OFF.
- Make sure not to block the sensor from the daylight source and adjust the light level potentiometer CW in small increments. (Pause 5 seconds between each adjustment)
- Lights will not turn ON upon occupancy activation, when the ambient light level exceeds the daylight threshold setting.

#### Time Delay Adjustments



People who remain very still for long periods of time may need a longer time delay than the default setting of 10 minutes. As long as the Self-adjusting feature is enabled, the switch will respond to each pair of false-OFFs with no normal OFF in between, by alternately making slight adjustments to either time delay (by 2 minute increments) or sensitivity, so there should be no need for manual adjustment. If manual adjustment is desired, refer to Time Delay settings in DIP switch legend.

Reset sensor time delay to factory settings by moving DIP switches 1 and 2 down. (If DIP switches 1 and 2 are already down, toggle DIP switch 1 out of its current position, wait 3 seconds, and then back to its original position)

#### Override

The Override setting allows the sensor to operate as a service switch in the unlikely event of failure.

- Move DIP switch 8 up.
- The pushbutton can be used to manually turn lights ON or OFF.

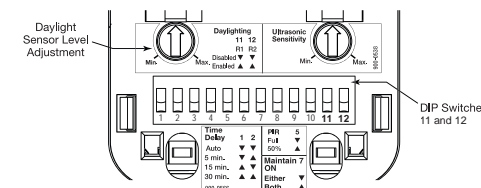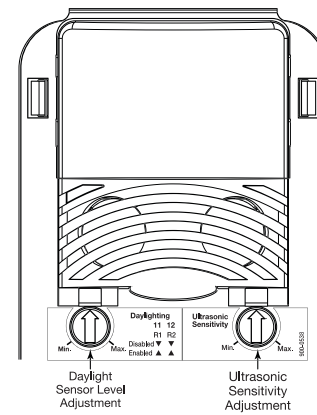

### Troubleshooting

Issue	Possible Causes	Suggestions
<b>Lights Will Not Turn ON automatically</b>	Sensor is in Manual ON mode	Press pushbutton. If Auto Mode is desired change Activation Mode to Auto
	Sensor was turned OFF manually. If the Sensor was turned OFF manually before the time delay expired, lights will remain OFF for the remainder of the time delay.	Check LEDs, if LEDs blink with motion. This is an indication that the lights were turned OFF manually. Press the pushbutton to turn the lights back ON
	Daylighting Feature Enabled	If all lights are required to turn ON adjust DIP Switches 11 and 12 and/or daylight potentiometer
<b>Lights Will Not Turn ON manually</b>	Power interruption	Check incoming voltage and/or wiring
	Daylighting Feature Enabled	If all lights are required adjust DIP Switches 11 and 12 and/or daylight potentiometer
	Power interruption	Check incoming voltage and/or wiring
	<b>If lights will still not turn ON, set sensor to override mode and call Technical Services at 1-800-553-3879</b>	
<b>Lights Will Not Turn OFF automatically</b>	Override	Make sure sensor is not in Override mode (DIP Switch 8 up)
	Self-Adjust	If sensor is in Self-Adjust Mode, it may be possible for the unit to have increased the time delay to a 30 minute delay. If the lights do not turn OFF after 30 minutes follow next step
	30 Minute Delay	Maximum time delay is 30 Minutes. Check DIP Switches to verify DIP Switch settings. If lights do not turn OFF at the set Time Delay, check next step
	Ultrasonic Sensitivity set High	Lower sensitivity by turning green potentiometer CCW in small decrements
<b>Lights Will Not Turn OFF manually</b>	PIR activated by heat source other than occupant	Move DIP Switch 5 up
		Call Technical Services
<b>If lights will still not turn OFF, call Technical Services at 1-800-553-3879</b>		

### Warranties and Limitation of Liability

Please refer to [www.cooperlighting.com](http://www.cooperlighting.com) under the Legal section for our terms and conditions.